



KOHNEN CONCRETE PRODUCTS, INC.

503 GREEN STREET
 GERMANTOWN, IL 62245
 618-523-4266
 Belleville 618-277-2120
 Fax 618-523-4751


PRECAST CONCRETE LIFT STATION FOR INSTALLATION BEFORE OR AFTER SEPTIC SYSTEMS & AERATION SYSTEMS

1. Contact our office for applications and pricing.
 - A. For installations before septic systems a 2" sewage pump should be used.
 - B. For installations following septic systems a 1 1/2" effluent pump is used.
2. C-56 1" sealant is used to seal the joints. 1 roll per joint.
3. Inlet piping should be installed at the joint of the base to provide adequate liquid depth.
4. Outlet piping should be located at the appropriate location to provide drainage from the lift station.
5. The top of the lid should be 5" above the final grade to prevent surface water entry to unit.

AVAILABLE ACCESSORIES

(Priced on Request)

- Sewage Pumps
- Effluent Pumps
- High Level Alarms
- Check Valves
- Joint Sealant
- PVC Piping
- Electrical Connection to Facility

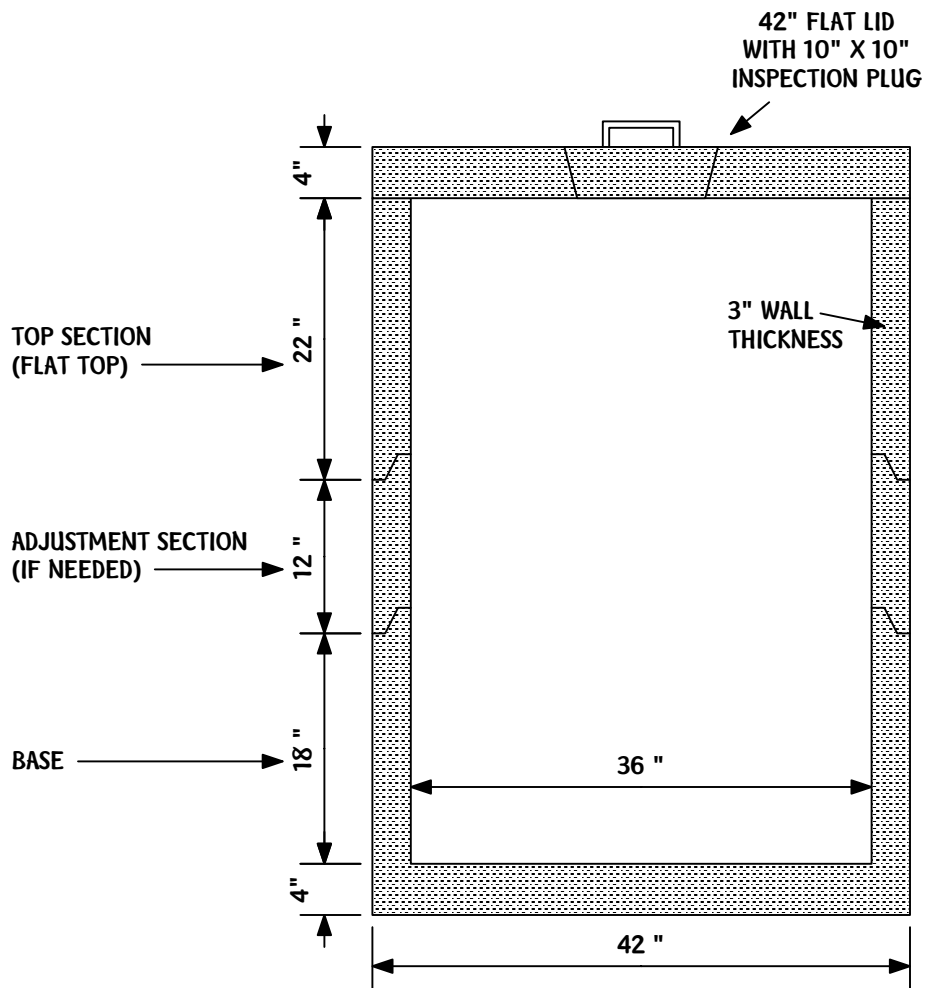

| | |
|----------------|----------|
| WEIGHT: | |
| 42" LID | 350 LBS |
| 22" SECTION | 650 LBS |
| 12" SECTION | 325 LBS |
| BASE | 1000 LBS |

* STORAGE CAPACITY IS 52 GALLONS PER FOOT